

# ActivePure® TECHNOLOGY

*ActivePure® Technology Animation Video*



Walter T. Mudu  
wt@mme.works  
718 415-4452

- 8 -

CONFIDENTIAL & PROPRIETARY INFORMATION • NOT FOR REDISTRIBUTION

Weldon Powe  
weldonpowe@icloud  
347-546-1698




Oxygen and humidity are converted into oxidizers using a process similar to what occurs in natural sunlight. These oxidizers are projected from the cell, enveloping the air and surrounding surfaces to seek out and destroy contaminants.

## *How does ActivePure® Technology work?*

1. Uses microscopic oxygen and moisture from the air
2. Converts into powerful microscopic oxidizers
3. Is propelled into the entire air space
4. Seeks pathogens in the air and on surfaces
5. Destroys pathogens on contact

ActivePure®  
Honeycomb  
Matrix

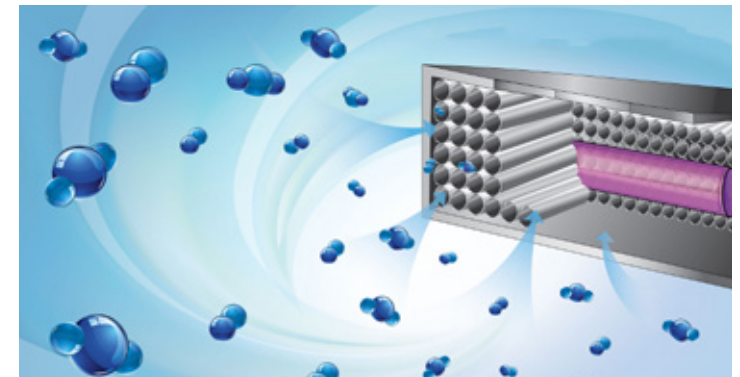

2017 Space Technology  
Hall of Fame Inductee

Weldon Powe  
weldonpowe@icloud  
347-546-1698

Walter T. Mudu  
wt@mme.works  
718 415-4452

**ELIMINATED OVER 99.9% OF AIRBORNE SARS-COV-2  
VIRUS IN JUST 3 MINUTES**


- Tested at UTMB CDC/Military Lab
- Tested per FDA

*“These results demonstrate the effectiveness of the technology”*

– Dr. William S. Lawrence, PhD  
Director of the Aerobiology Services Division  
UTMB’s Galveston National Laboratory



Test Results for ActivePure®  
SARS-CoV-2 (COVID 19) in the Air

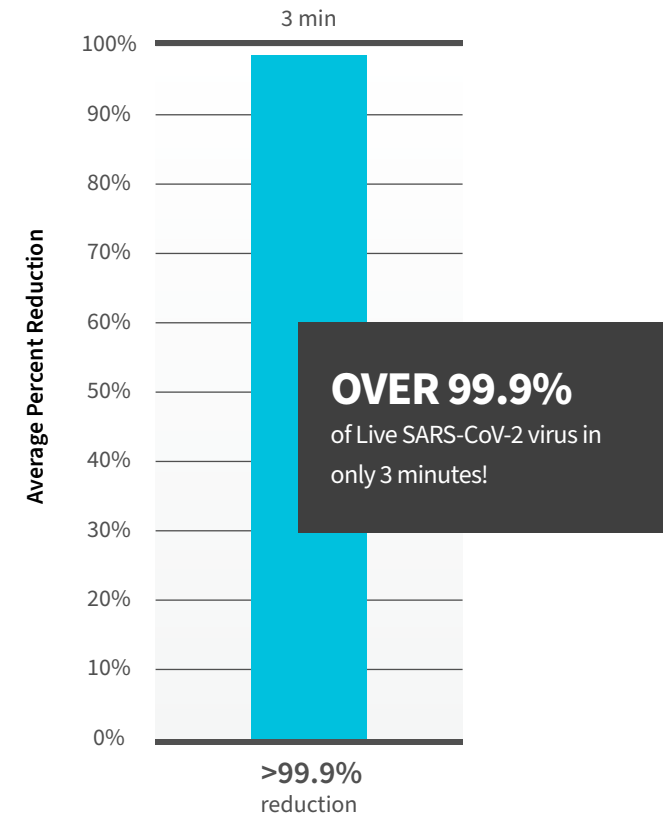

Outside of control group - over 99.9% reduction of SARS-CoV-2.




## ELIMINATED OVER 99.9% OF SURFACE SARS-COV-2 VIRUS



### Preface

- Tested at MRIGlobal
- Tested per FDA guidelines and protocols



Test Results for ActivePure® SARS-CoV-2 on Surfaces

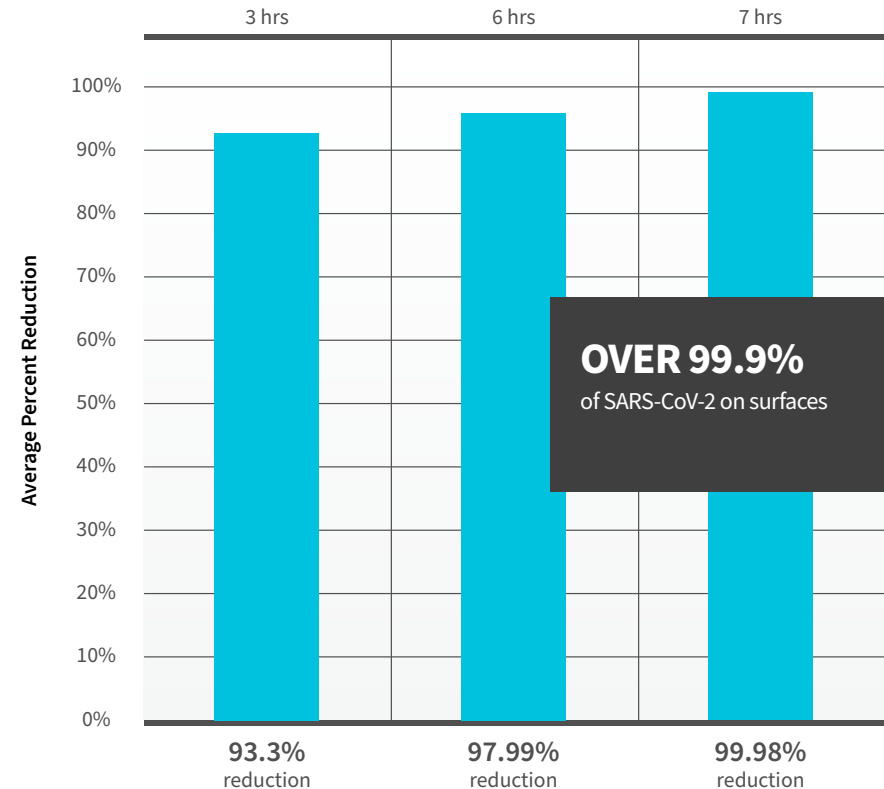

Outside of control group - over 99.9% reduction of SARS-CoV-2.




## FDA MEDICAL DEVICE TESTING **AGAINST RNA VIRUS AND DNA VIRUS.**

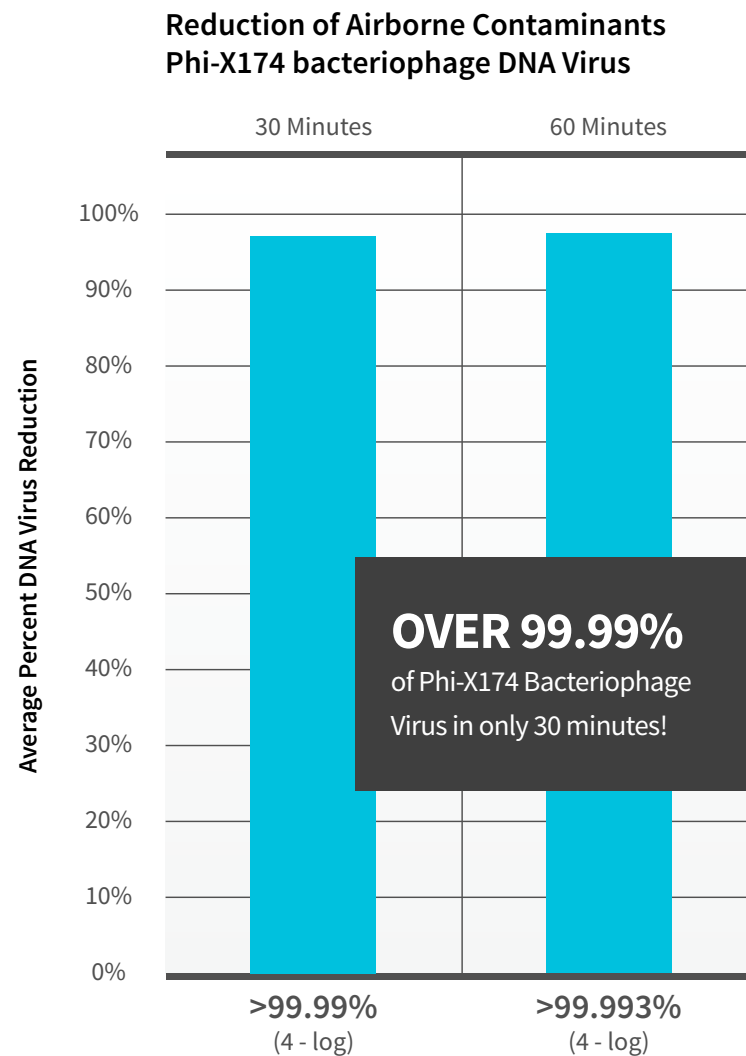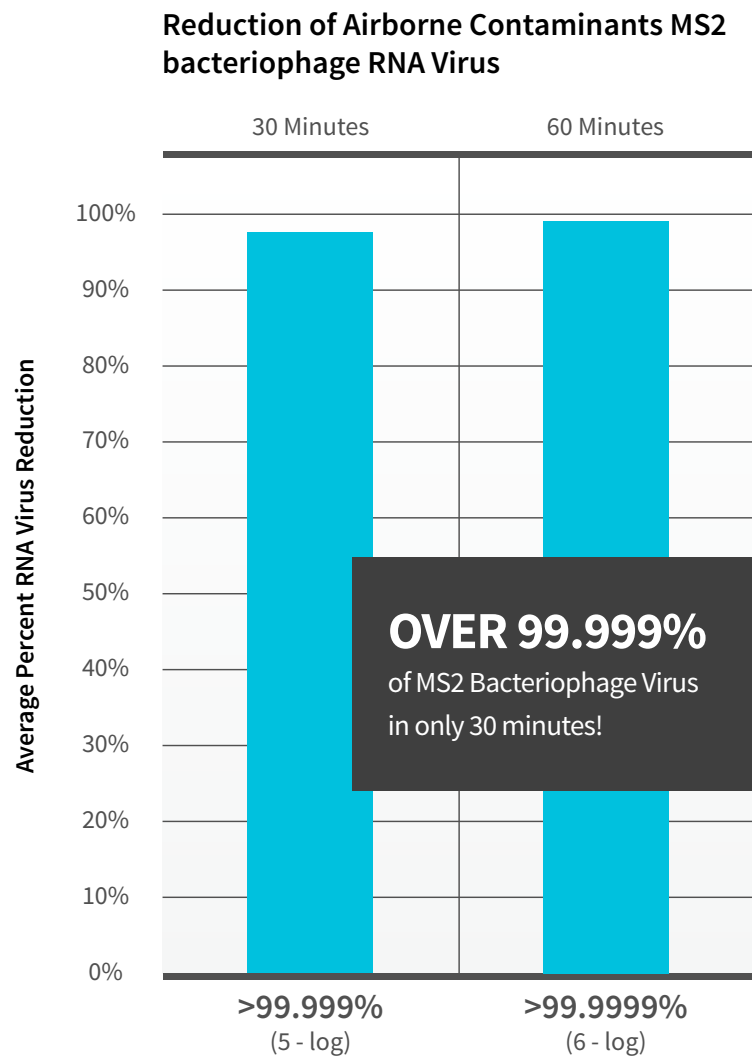




## FDA MEDICAL DEVICE TESTING **AGAINST GRAM-POSITIVE AND GRAM-NEGATIVE BACTERIA.**



Reduction of Airborne Contaminants  
Staphylococcus epidermidis –  
Gram-positive Bacteria

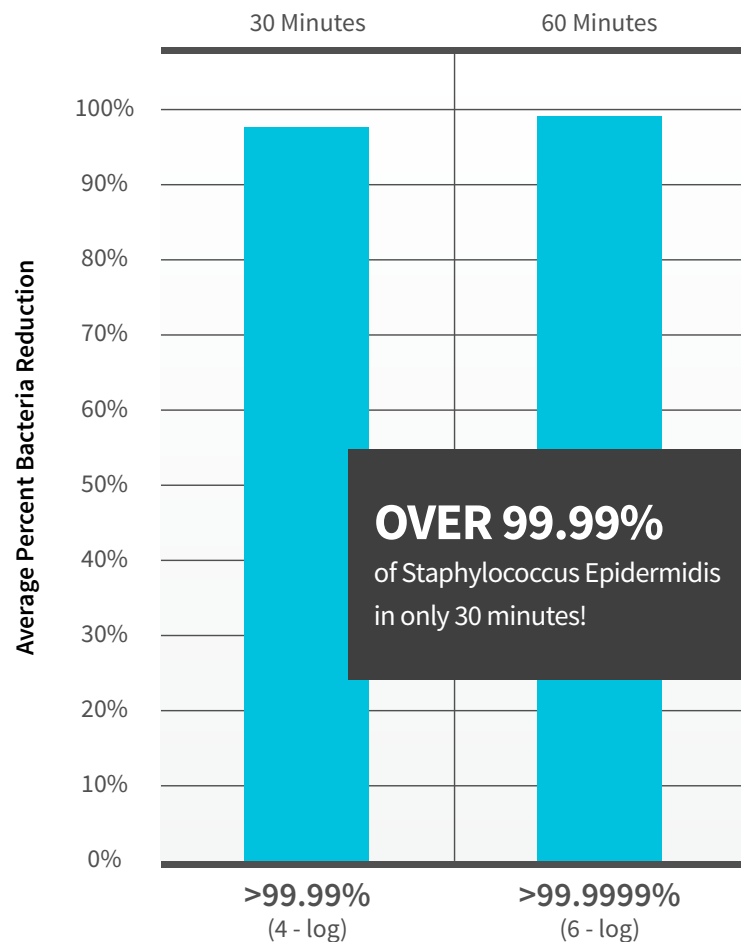

Reduction of Airborne Contaminants  
Erwinia herbicola – Gram-negative Bacteria

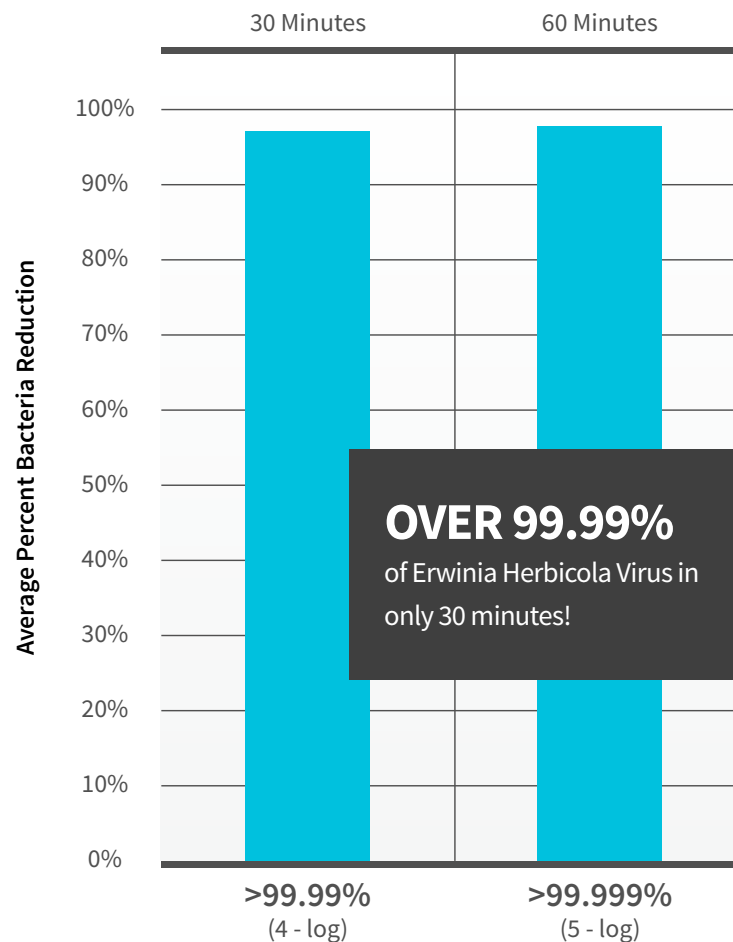

## FDA MEDICAL DEVICE TESTING **AGAINST FUNGAL MOLD** **AND BACTERIAL MOLD.**

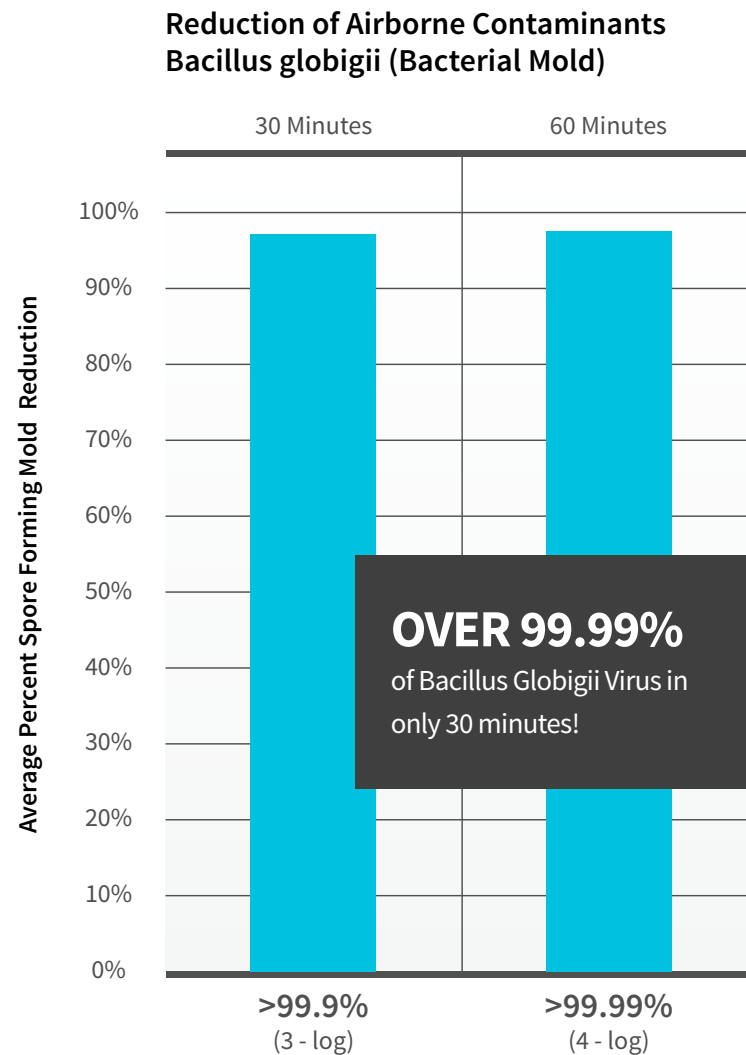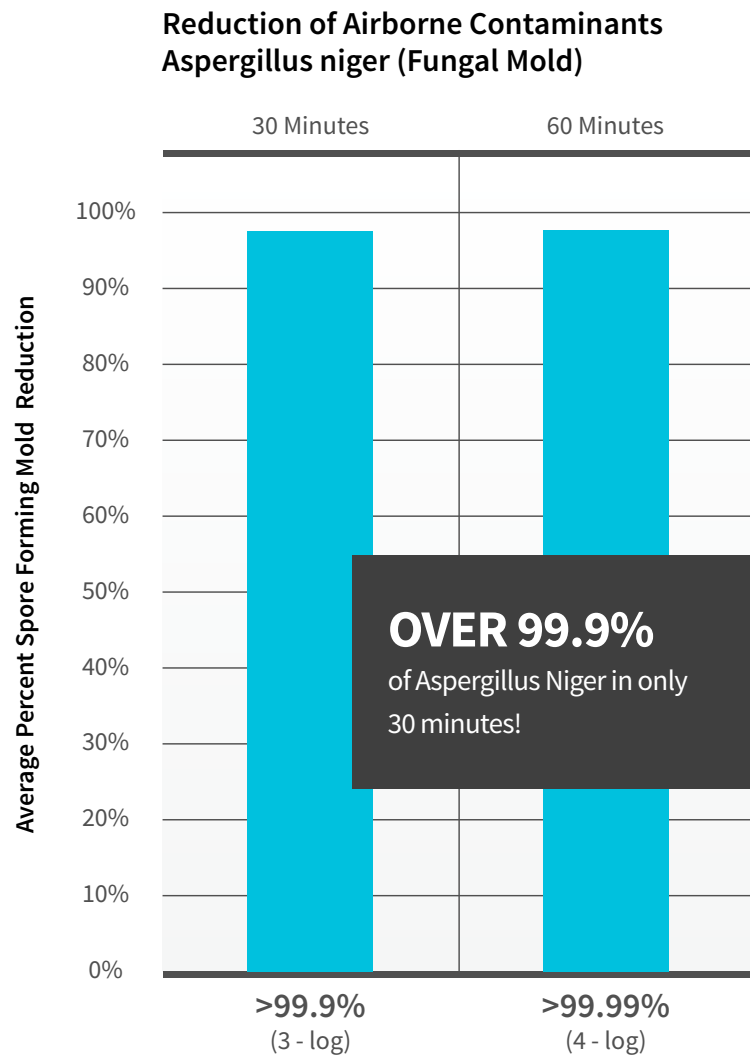

Walter T. Mudu  
wt@mme.works  
718 415-4452

Weldon Powe  
weldonpowe@icloud  
347-546-1698

ACTIVEPURE® ALSO PROVEN TO DESTROY **OVER 99.9% OF:**

- Avian Flu
- Candida Albicans
- E. Coli
- Hepatitis A
- Legionella Pneumophila
- Listeria Monocytogenes
- MRSA
- Murine Norovirus
- Pseudomonas spp.
- SARS-Cov-2 Coronavirus
- Smoke
- Stachybotrys Chartarum
- Staphylococcus Aureus
- Streptococcus spp.
- Swine Flu

Field results may vary based on environmental conditions. These results have not been certified by the FDA.






# What measures are we taking today to help combat the spread of virus and pathogens in the workplace?


Working from Home



Social Distancing

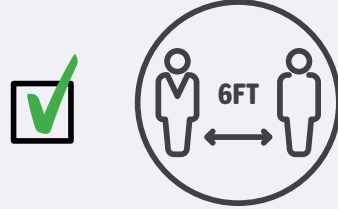

Masks

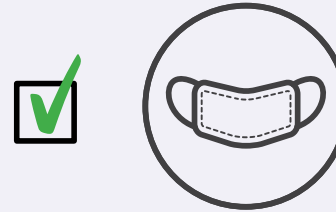

Gloves



Sanitizer



Disinfectant Sprays



Passive Air Systems



Vaccines



While this is helpful, is it enough?

## The Missing Link? **ActivePure®!**